

**nLIGHT AIR:
CLASSROOM - AIR ENABLED FIXTURES**

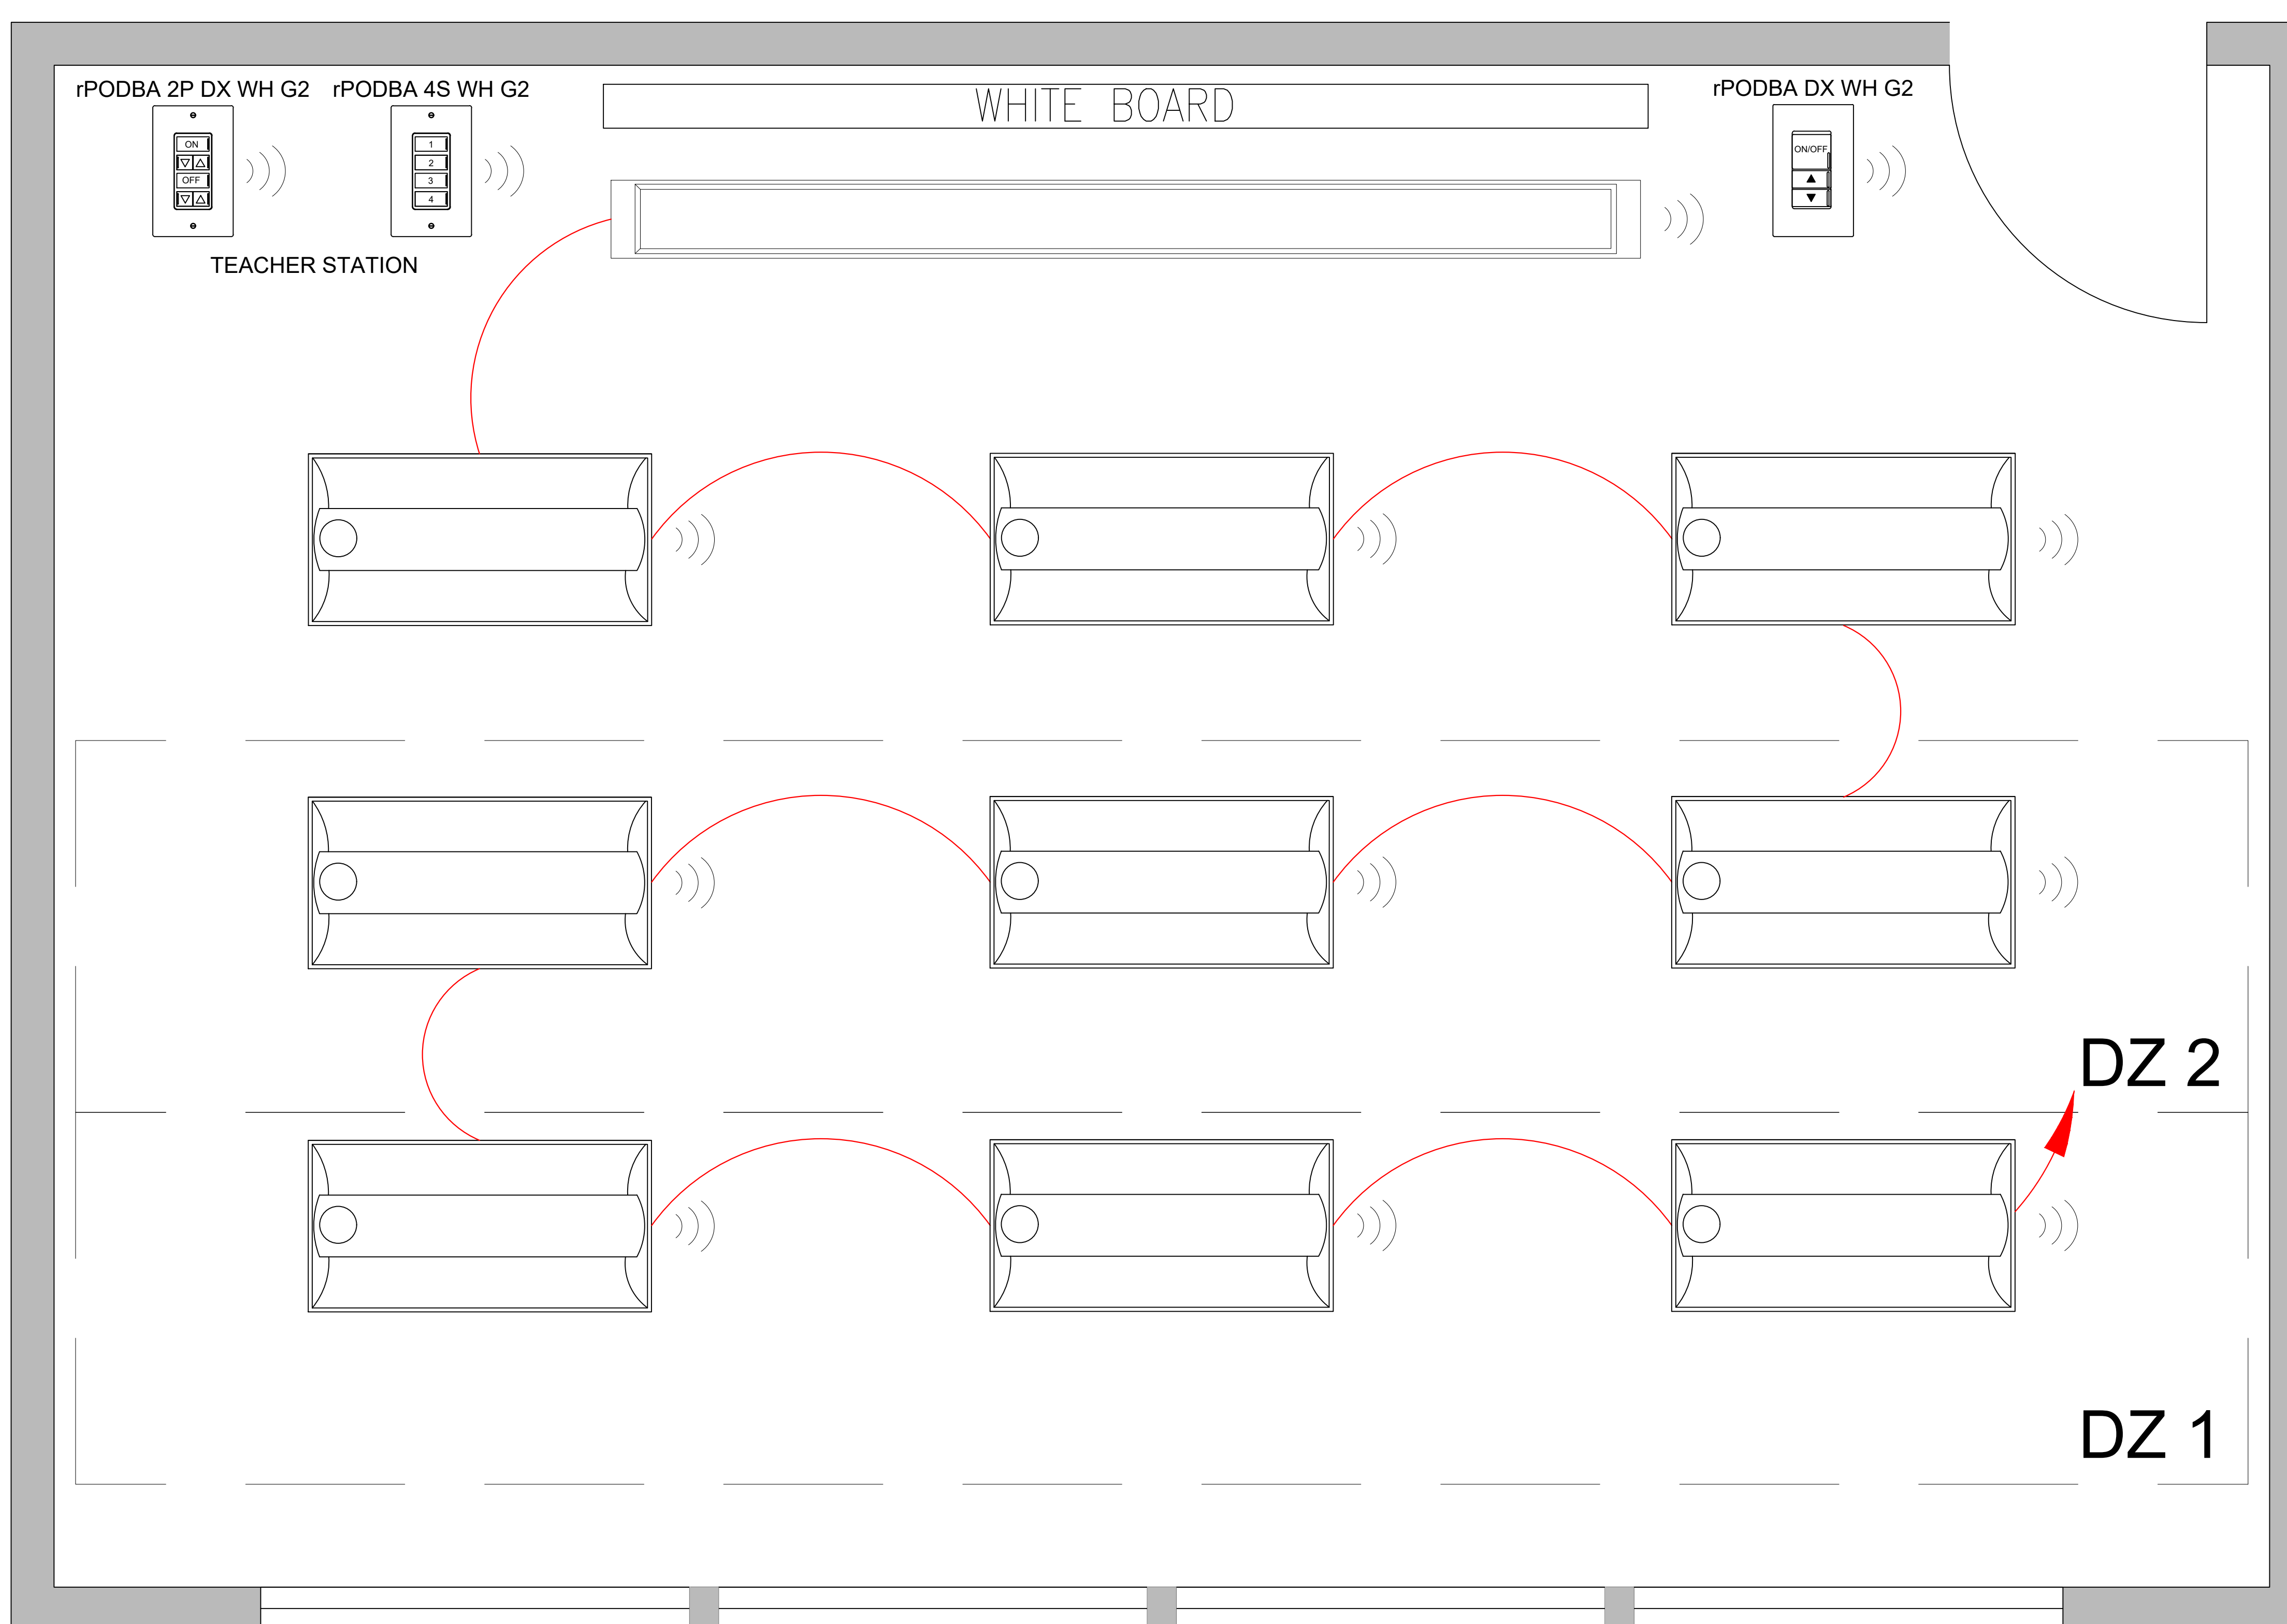


DIAGRAM LEGEND

- LINE VOLTAGE WIRES
- LINE POWER



FOR nLIGHT DESIGN ASSISTANCE OR A COMPLETE BOM ON PROJECT - CONTACT SDLA @ CONTROLS@SDLTG.COM OR (858)505-1055

SUPPORTS THE FOLLOWING REQUIREMENTS:

- MANUAL AREA CONTROLS (SECTION 130.1(a))
- MULTI-LEVEL LIGHTING CONTROLS (SECTION 130.1(b))
- SHUT-OFF CONTROLS (SECTION 130.1(c))
- AUTOMATIC DAYLIGHTING CONTROLS (SECTION 130.1(d))
- DEMAND RESPONSE (ADR) CONTROLS (SECTION 130.1(e))
- CONTROLS INTERACTIONS (SECTION 130.1(f))
- CONTROLLED RECEPTACLES (SECTION 130.5(d))

SEE SDLA BASIS OF DESIGN TO COMPLY WITH TITLE 24 SECTION 120.8(c)